

BRISTOL



AUTOMATIC SPRINKLERS


UPRIGHT, PENDENT, HORIZONTAL SIDEWALL & CONCEALED PENDENT





CONTENTS

| | |
|-------------------------------------|---|
| Upright Sprinkler | 3 |
| Pendent Sprinkler | 3 |
| Horizontal Sidewall Sprinkler | 4 |
| Concealed Pendent Sprinkler | 5 |
| Alarm Check Valve | 7 |

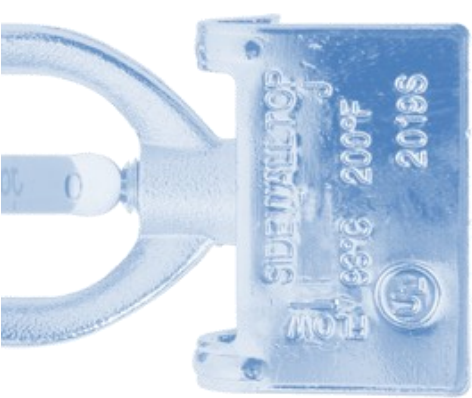

HORIZONTAL SIDEWALL SPRINKLER

MODEL: BF007 / BF008 STANDARD SPRAY, STANDARD / QUICK RESPONSE, 5/3mm BULB TYPE, K5.6, 1/2" CONNECTING THREAD

Description

Horizontal sidewall sprinklers are generally used in lieu of pendent and upright sprinklers because of building construction or installation economy considerations. They are designed for installation along a wall or the side of a beam and just beneath a smooth ceiling. Installed with their centerline of waterway horizontal, these sprinklers produce a quarter-spherical water discharge pattern that is predominately directed downward and outward from the deflector; however, a portion of the spray is also directed towards the back wall.

Model BF007/BF008, Standard / Quick Response Horizontal Sidewall Sprinklers (Ref. Figure A), are automatic sprinklers of the frangible bulb type, and standard spray, 1/2" orifice, 5 / 3 mm bulb. They are "standard / quick response - standard orifice sidewall sprinklers" intended for use in fire sprinkler systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency (e.g., UL Listing is based on NFPA 13 requirements)

Sprinkler Operation

During a fire conditions, the thermal-sensitive liquid in the glass bulb expands, causing the bulb to shatter, releasing the button and spring seal assembly. Water flowing through the sprinkler orifice strikes the sprinkler deflector, forming a uniform spray pattern to extinguish or control the fire.

Coverage

For coverage area and sprinkler placement, refer to NFPA13 standards.

Sprinkler Materials

| | |
|--------------------------|------------------------------|
| Frame | Brass Casting DZR |
| Deflector..... | Brass UNS-28000 |
| Glass Bulb..... | Glass with Glycerin Solution |
| | JOB® G5 for BF007 |
| | JOB® F3 for BF008 |
| Set Screw..... | Brass UNS-28000 |
| Button..... | Brass UNS-62300 |
| Spring..... | Stainless Steel |
| Seal..... | Teflon Tape |
| Standard Escutcheon..... | Cold Rolled Steel |



Technical Specifications:



| Model & Sprinkler I.D. No. | BF007 | BF008 |
|------------------------------|-------------------------------|----------------------|
| Style | Horizontal Sidewall | |
| Bulb Nominal Dia. & Response | Ø5mm, Standard Response | Ø3mm, Quick Response |
| Thread Size | NPT 1/2 | |
| Nominal Orifice Size | 1/2 Inch | |
| Nominal K-factor | 5.6 (U.S.) / 80 (metric) | |
| Max. Working Pressure | 175 psig / 1.2 MPa (12 bar) | |
| Factory Hydrostatic Test | 100% @ 500 psig (3.4 MPa) | |
| Min. Operating Pressure | 7 psig / 0.048 MPa (0.48 bar) | |
| Sprinkler Finish | Chrome Plated | |
| Listings and Approvals | UL | |

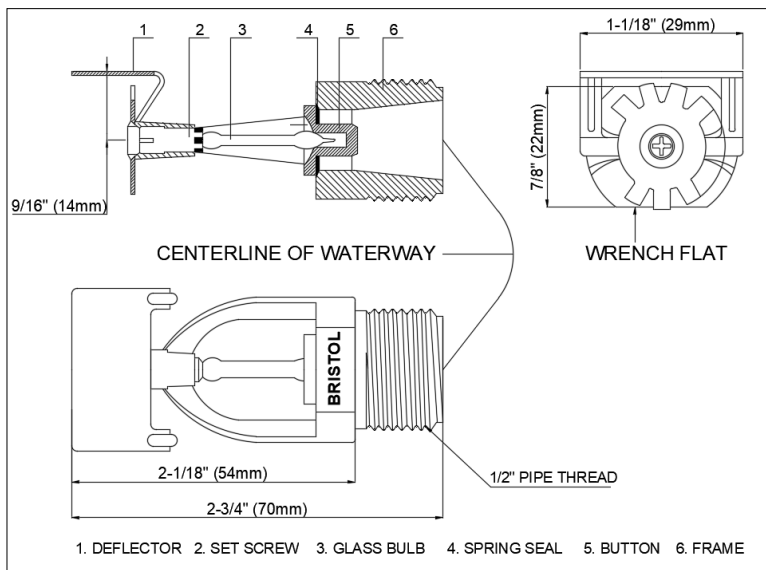


FIGURE A: MODEL BF007 / BF008 HORIZONTAL SIDEWALL SPRINKLERS



CONCEALED PENDENT SPRINKLER

MODEL: BF007 / BF008 STANDARD SPRAY, STANDARD / QUICK RESPONSE, 5/3mm BULB TYPE, K5.6, 1/2" CONNECTING THREAD



Description

The BF003/BF006 Standard/Quick Response Concealed Pendent Sprinklers (Ref. Figure A) are automatic sprinklers of the frangible bulb type. They are "standard/quick response – standard orifice spray sprinkler" intended for use in fire sprinkler systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency (e.g., UL Listing is based on NFPA 13 requirements). The Concealed Pendent Sprinklers all produce a hemispherical water distribution pattern below the deflector.

This model sprinkler includes a Cover Plate Assembly that conceals the sprinkler operating components above the ceiling. The Cover Plate Assembly, which installs onto the Sprinkler/ Mounting Cup Assembly, consists of a Cover Plate that is soldered to an Enclosure at three equidistant locations around their peripheries. The Ejection Spring is located between the flange of the Enclosure and the Cover Plate, to ensure separation of the two pieces when the solder melts.

A Label located on the Cover Plate Assembly indicates the nominal temperature of the sprinkler and the nominal diameter of the Glass Bulb.

The small Cover Plate is flat with a low profile that blends in with the ceiling for an aesthetically pleasing appearance. Standard finishes for the Cover Plate are satin chrome plated and painted white. Other factory applied painted finishes for the Cover Plate is available on special order

The separable two-piece design of the Cover Plate and Mounting Cup Assemblies allows installation of the sprinklers and pressure testing of the fire protection system prior to installation of a suspended ceiling or application of the finish coating to a fixed ceiling. The separable design also permits removal of suspended ceiling panels for access to building service equipment, without having to first shut down the fire protection system and remove sprinklers.

Also, the separable two piece design of the BF003 / BF006 Concealed Sprinkler provides for 1/6 inch (4.2mm) of vertical adjustment, to reduce the accuracy to which the length of fixed pipe drops to the sprinklers must be cut

Coverage

For coverage area and sprinkler placement, refer to NFPA13 standards.


Sprinkler Operation

During a fire conditions, the thermal-sensitive liquid in the glass bulb expands, causing the bulb to shatter, releasing the button and spring seal assembly. Water flowing through the sprinkler orifice strikes the sprinkler deflector, forming a uniform spray pattern to extinguish or control the fire.

Sprinkler Materials

| | |
|----------------------|-----------------------------------|
| Frame | Brass Forging UNS-C87400 |
| Deflector..... | Brass UNS-28000 |
| Glass Bulb..... | Glass with Glycerin Solution |
| | JOB@ G5 for BF003 |
| | JOB@ F3 for BF006 |
| Set Screw..... | Brass UNS-28000 |
| Button..... | Brass UNS-62300 |
| Mounting Cup..... | Low Carbon Sheet Steel UNS-G10080 |
| Enclosure..... | Brass UNS-C2800 |
| Ejection Spring..... | Stainless Steel UNS-s30452 |
| Spring..... | Stainless Steel |
| Seal..... | Teflon Tape |
| Label..... | Mylar (Sticky - Back) |

Technical Specifications:



| Model & Sprinkler I.D. No. | BF003 | BF006 |
|------------------------------|-------------------------------|----------------------|
| Style | Concealed Pendent | |
| Bulb Nominal Dia. & Response | Ø5mm, Standard Response | Ø3mm, Quick Response |
| Thread Size | NPT 1/2" | |
| Nominal Orifice Size | 1/2 Inch | |
| Nominal K-factor1 | 5.6 (U.S.) / 80 (metric) | |
| Max. Working Pressure | 175 psig / 1.2 MPa (12 bar) | |
| Factory Hydrostatic Test | 100% @ 500 psig (3.4 MPa) | |
| Min. Operating Pressure | 7 psig / 0.048 MPa (0.48 bar) | |
| Sprinkler Finish | Chrome Plated | |
| Listings and Approvals | UL | |


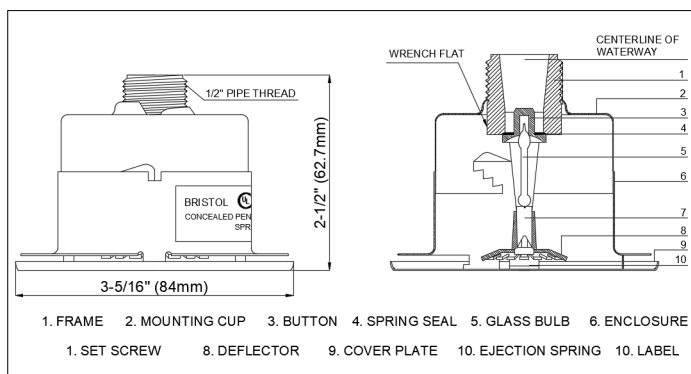


FIGURE A: MODEL BF003 / BF006 CONCEALED PENDENT SPRINKLERS



MODEL: BF001 / BF005 / BF002 / BF004 /
 BF003 / BF006 / BF007 / BF008
 STANDARD SPRAY, STANDARD / QUICK
 RESPONSE,
 5/3mm BULB TYPE, K5.6, 1/2" CONNECTING
 THREAD

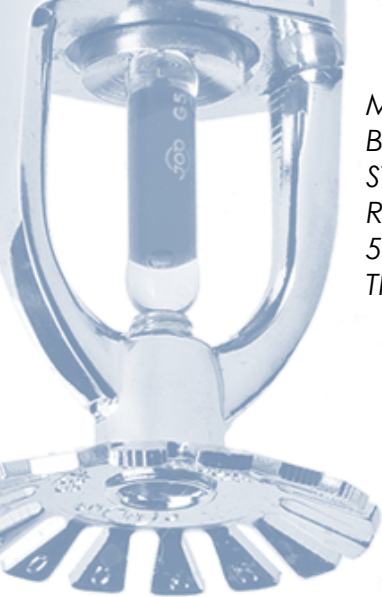

Available Temperature Rating

| Temp. Classification | Ordinary | Ordinary | Intermediate | Intermediate |
|---|--------------|--------------|--------------|--------------|
| Nominal Temp. Rating | 135°F / 57°C | 155°F / 68°C | 175°F / 79°C | 200°F / 93°C |
| Max. Ambient Temp. Allowed ⁵ | 115°F / 46°C | 135°F / 57°C | 155°F / 68°C | 180°F / 82°C |
| Max. Recommended Ambient Temp. ⁶ | 100°F / 38°C | 100°F / 38°C | 150°F / 65°C | 150°F / 65°C |
| Glass Bulb Color | Orange | Red | Yellow | Green |

Discharge Coefficient

Sprinklers are rated for use at a maximum service pressure of 175 psig (12 bar). The nominal discharge curve plotted in Figure B represents the flow "Q" in GPM (LPM) as determined by the following formula:

$$Q = K (P)^{0.5}$$

Where,


Q = Flow, GPM (LPM)

K = Discharge Coefficient, K = 5.6 (80)

P = Discharge Pressure, psig (bar)

Accessories

| | |
|---------------------|-----|
| Standard Escutcheon | |
| Type | E-1 |
| Installation Wrench | |
| Type | T-1 |

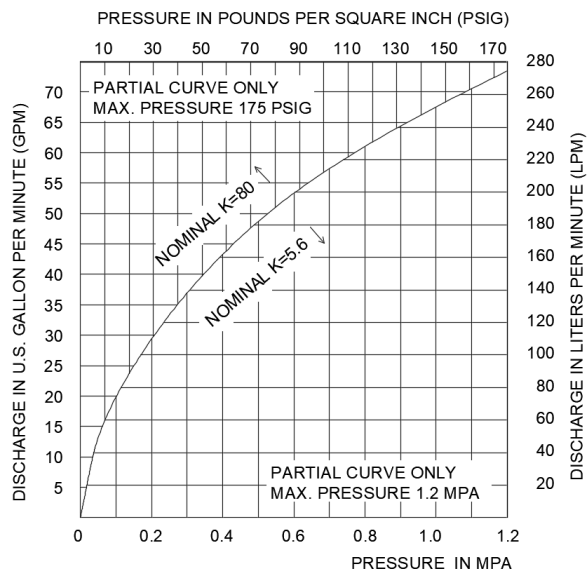



ALARM CHECK VALVE

Model No.: BAV-146

Model BAV-146 Alarm Check Valve is a wet pipe sprinkler system water supply check valve that makes possible the installation of sprinkler systems in buildings not subject to freezing temperatures. It is designed so that water pressure in the piping system will hold back water pressure at the valve until a significant flow of water occurs. The Alarm Check Valve serves as a check valve by trapping pressurized water above the clapper and preventing reverse flow from sprinkler piping.



| Size | 4" (DN100) | 6" (DN150) |
|-------------------------|--|--------------|
| Inlet Connection Style | Flange | Flange |
| Outlet Connection Style | Flange | Flange |
| Shipping Weight | 55 lbs/25 kg | 75 lbs/34 kg |
| Max. Working Pressure | 235 psig/1.6 MPa (12 bar) | |
| Factory Hydro Test | 100% @ 470 psig/3.2 MPa (32 bar) | |
| Standard Finish | Red Painted | |
| Flange Specification | Flange: Class 150 ANSI B16.1 | |
| Required Accessories | Standard Trim | |
| Optional Accessories | Retard Chamber, Water Motor Alarm, Alarm Pressure Switch | |
| Installation Manner | Vertically | |
| Listings and Approvals | UL (United States) | |

OPTIONAL ACCESSORIES:

- **Retard Chamber**

The Retard Chamber is required when the Alarm Check Valve is installed on systems with a variable pressure water supply in order to reduce the possibility of false alarms.

- **Water Motor Alarm**

The Alarm Check Valve is designed to activate a mechanical alarm during a sustained flow of water (such as the flow required by an open sprinkler) causes the alarm check's clapper to lift from its seat.

- **Alarm Pressure Switch**

The Alarm Check Valve trim allows installation of pressure switches to operate local electric alarms and/or remote electric alarms during a sustained flow of water (such as the flow requires by an open sprinkler).

Over 100 Distributors Worldwide

UAE Offices

Abu Dhabi

Concorde Trading Company

Tel: +971 2 6668770 Fax: +971 2 6667863

Concorde Trading Showroom

Tel: +971 2 4433317 Fax: +971 2 4434746

Concorde Technical Company

Tel: +971 2 5575551 Fax: +971 2 5575550

Bristol Vehicles Manufacturing Division

Tel: +971 2 5575551 Fax: +971 2 5575550

Al Ain

Concorde Trading Company

Tel: +971 3 7642267 Fax: +971 3 7642268

Sharjah

Corodex Agencies

Tel: +971 6 5430800 Fax: +971 6 5430801

Dubai

Corodex Trading Company

Tel: +971 4 3472900 Fax: +971 4 3472796

Corodex Agencies (Fire Protection & Automation)

Tel: +971 4 3472530 Fax: +971 4 3472501

Bristol Fire Engineering

Tel: +971 4 3472426 Fax: +971 4 3472363

Corodex Agencies (Safety & Rescue)

Tel: +971 4 2668966 Fax: +971 4 2624617

International Offices

Oman

Integrated Engineering Solutions (IES)

Tel: +968 24700349 Fax: +968 24700631

KSA

Concorde Advance Technical Solutions

Tel: +966 12 6984993 Fax: +966 12 6984991



Intertek



NFPA

FM

APPROVED



LISTED

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

CE

BRISTOL

FIRE ENGINEERING

P.o.Box 74582 Dubai, UAE

Tel: +971 4 3472426 Fax: +971 4 3472363

Email: sales@bristol-fire.com, www.bristol-fire.com

Member of



Since 1974

Concorde - Corodex Group

